
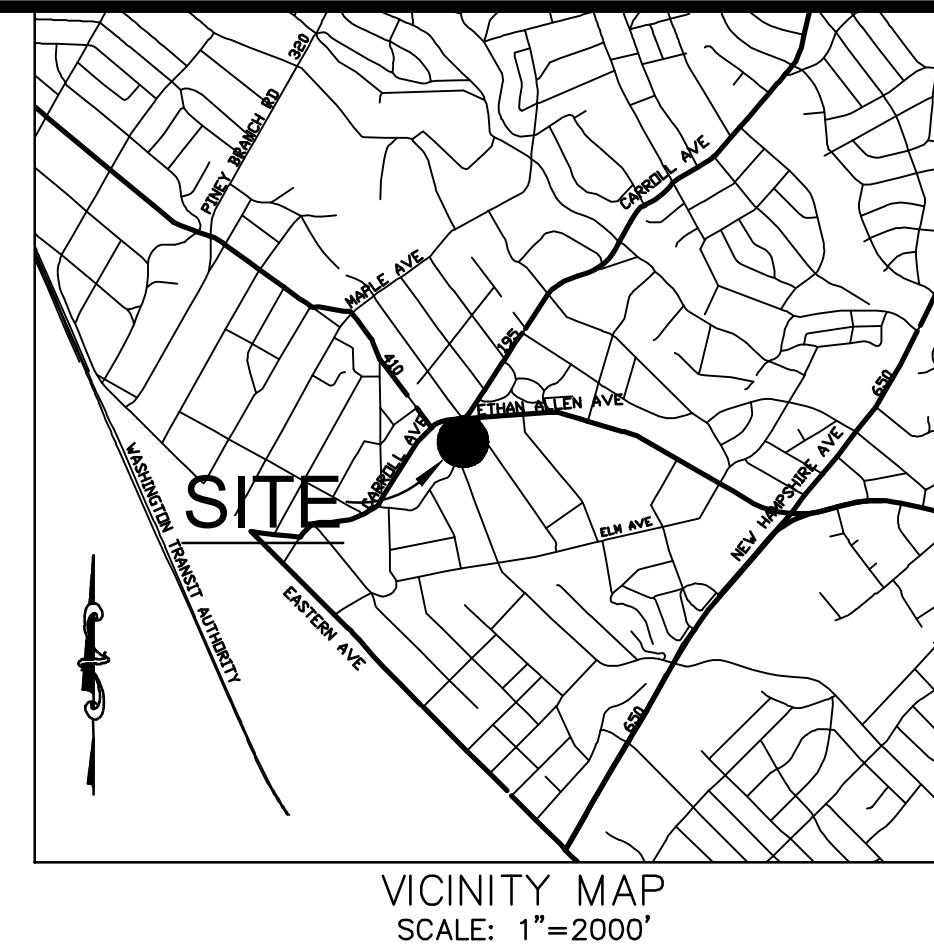


E-FILE STAMP

LEGEND:

- F.F. FINISHED FLOOR ELEVATION DATA ACCORDING TO RECORDS
- DATR DUCTILE IRON PIPE
- DIP REINFORCED CONCRETE PIPE
- RCP CORRUGATED PLASTIC PIPE
- CPP CORRUATED PLASTIC PIPE
- TREE
- ROOF DRAIN
- SIGN
- ELECTRIC MANHOLE
- LIGHT POLE
- POWER POLE
- ELECTRIC JUNCTION BOX
- SANITARY SEWER MANHOLE
- CLEAN OUT
- GAS VALVE
- GAS METER
- HANDICAP PARKING SPACE
- BOLLARD
- DRAIN
- CURB & GUTTER
- RIGHT OF WAY LINE
- BUILDING

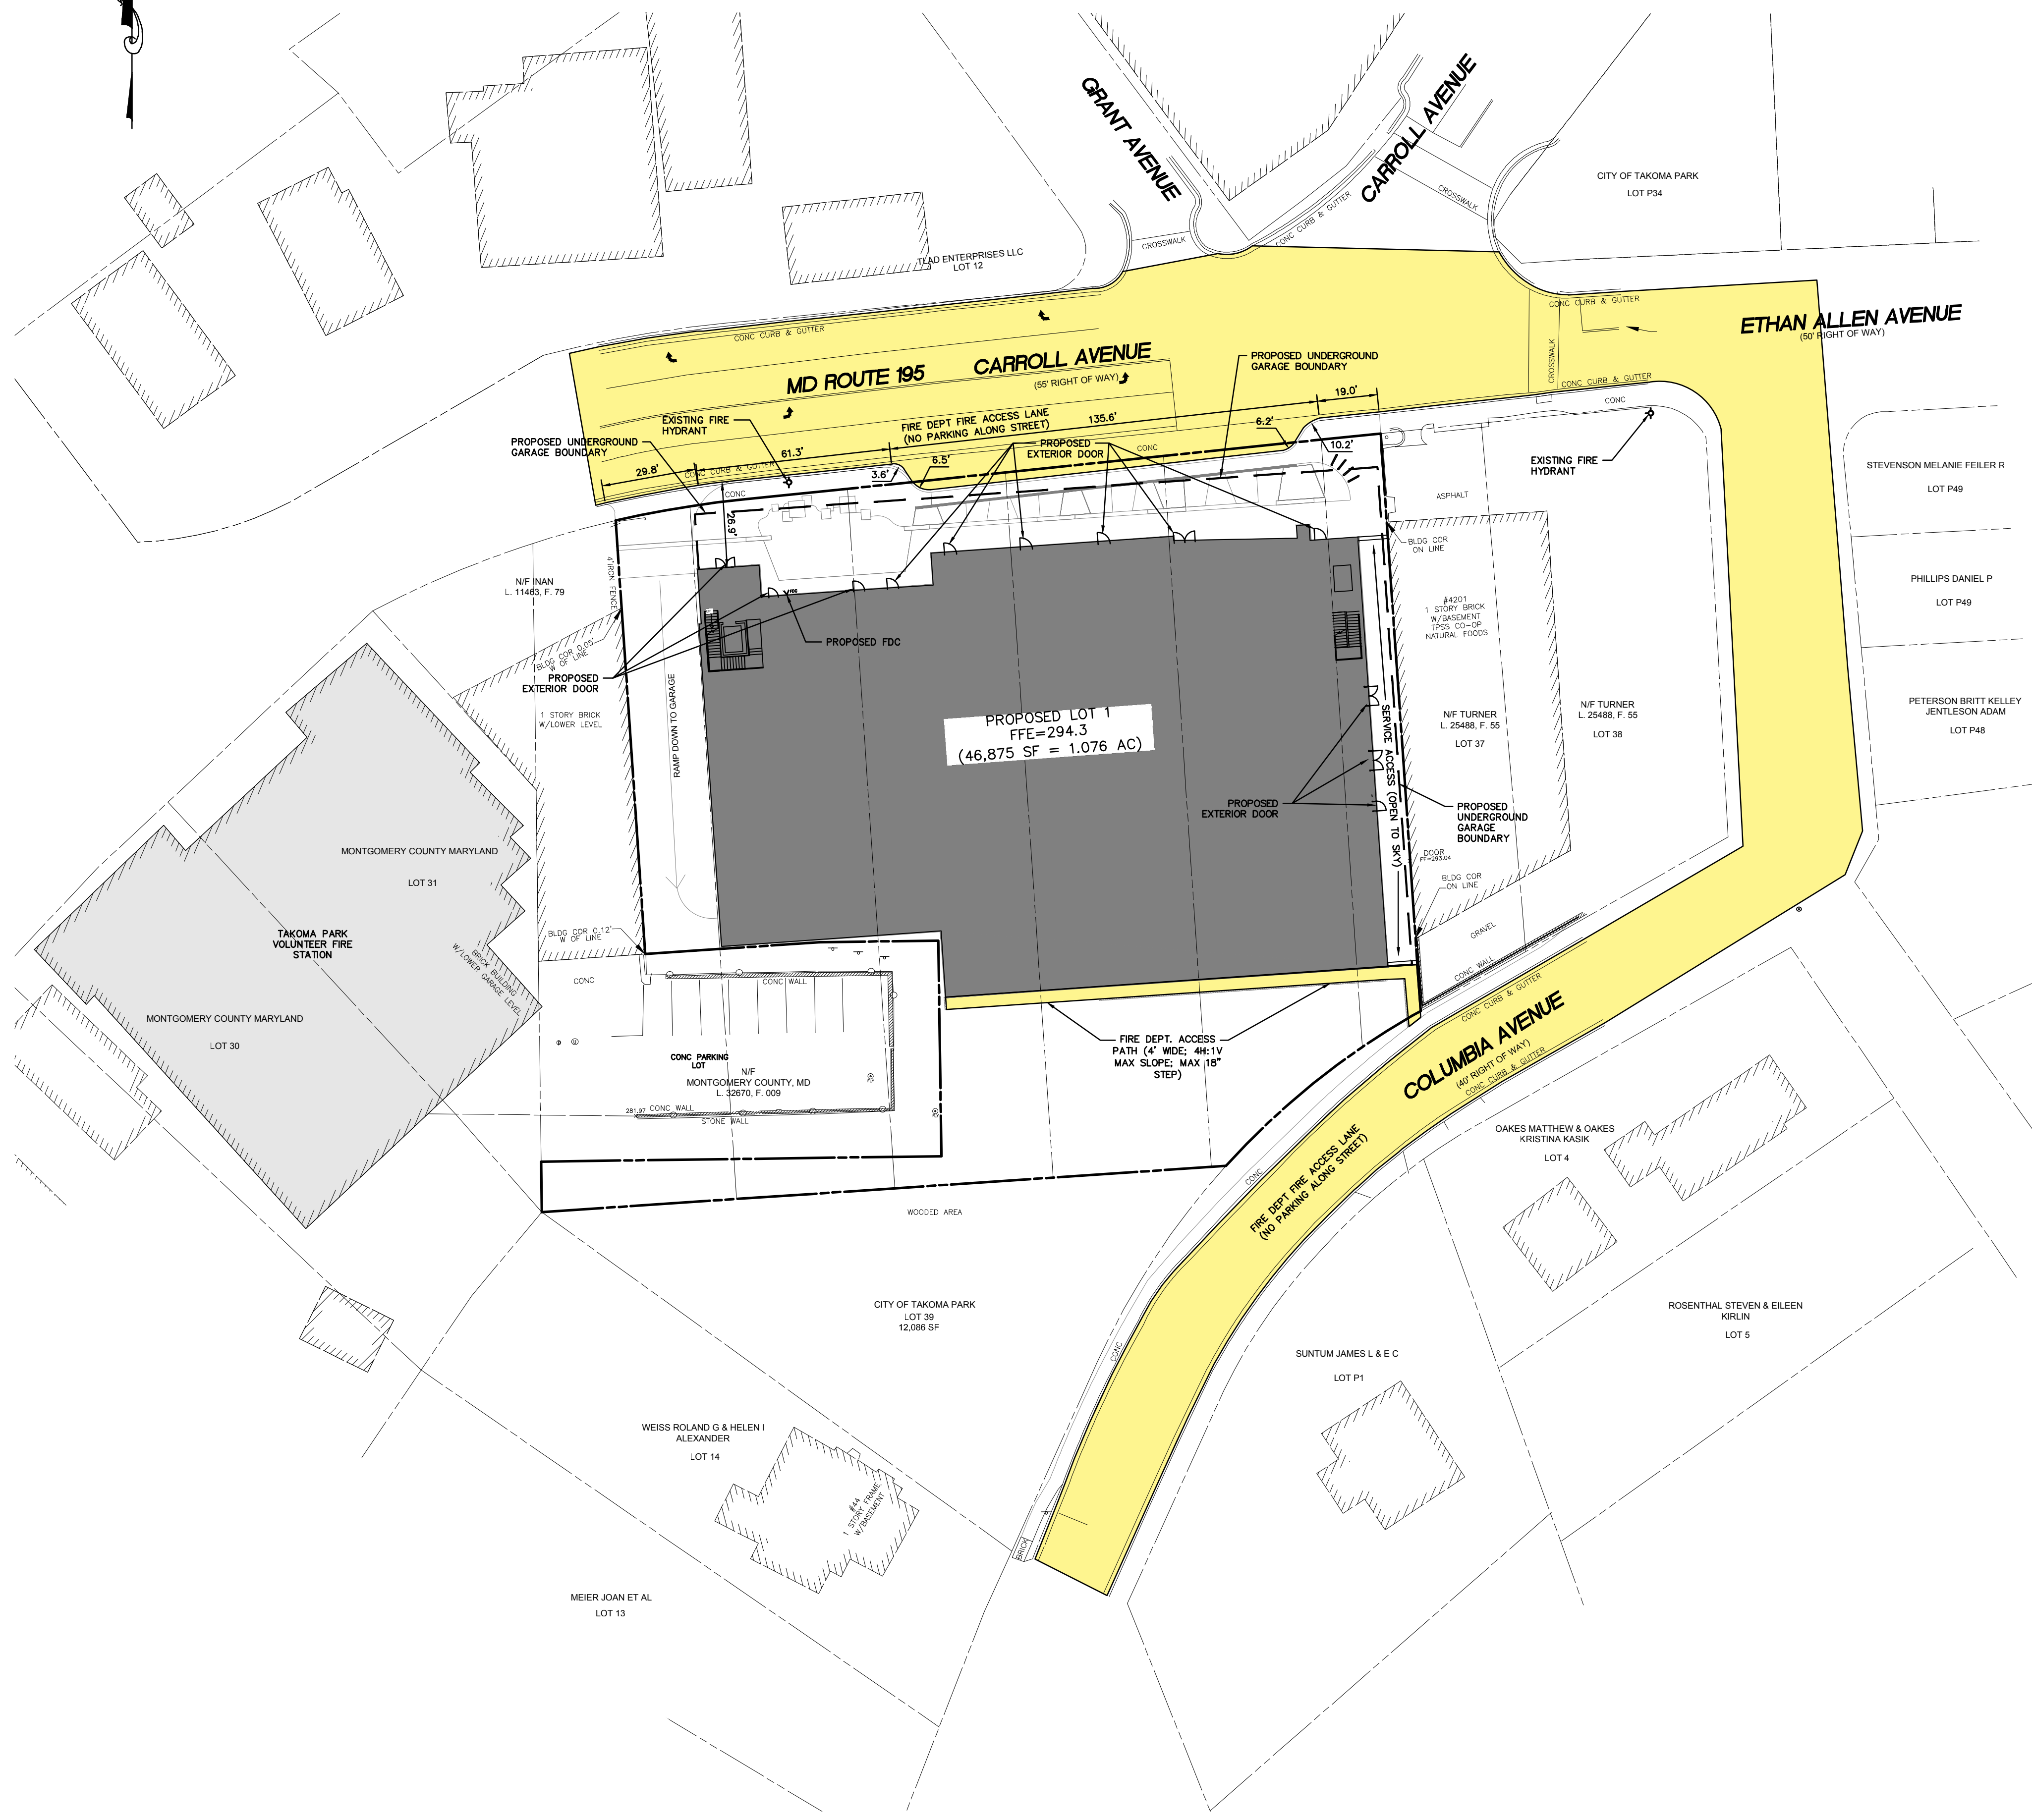

AMT LLC
 PROFESSIONAL ENGINEERS
 LAND SURVEYORS
 LANDSCAPE ARCHITECTS
 10 G STREET, NE, SUITE 430
 WASHINGTON, DC, 20002
 PH: (202) 289-4545
 FAX: (202) 289-5051

PRELIMINARY PLAN #120190150
TAKOMA JUNCTION
 13TH ELECTION DISTRICT
 CITY OF TAKOMA PARK
 MONTGOMERY COUNTY, MARYLAND
 TAX MAP: JN51
 WSSC GRID: 208NE01 & 209NE01

| WSSC Where Water Matters | | COMMISSIONERS | |
|--|--|--|------------------------------|
| 14501 Switzer Lane • Laurel, Maryland 20707-9801 | | Pamela M. Bennett, Chair Chris Leonard, Vice Chair Omer M. Bekarawa Howard A. Davis T. Eddie Foster Thomasina V. Rogers | |
| GENERAL MANAGER Carla A. Rest | | | |
| CUSTOMER INFORMATION | | | |
| FLOW TEST PREPARED FOR: | Immermann and Kenney Properties | | |
| CONTACT PERSON | Tom Kenney | | |
| ADDRESS: | 7107 Poplar Ave, Takoma Park, MD 20912 | | |
| TELE. # | 301-651-6432 | | |
| FAX # | n/a | | |
| EMAIL: | immermannkenney@gmail.com | | |
| FIRE FLOW TEST INFORMATION | | | |
| TEST LOCATION | TEST DATE | TIME OF TEST | 200-FT. SHL. MAP PAGE GRID # |
| 7322 Carroll Ave | 4/18/17 | 11:26AM | 209NE01 35408 E04 |
| FLOW TEST RESULTS | | | |
| TEST HYDRANT (S&R) No. | F114 | | |
| FLOW HYDRANT (FLOW) No. | F115 | | |
| ELEVATION @S&R HYDRANT (FT) | 284 | | |
| ELEVATION @FLOW HYDRANT (FT) | 280 | | |
| HHG: | 500 | | |
| LHG: | 419 | | |
| STATIC PRESSURE (PSI): | 50 | | |
| RESIDUAL PRESSURE (PSI): | 78 | | |
| PITOT FLOW (GPM) | 2015 | | |
| MAIN LINE SIZE (IN) | 8 | | |
| RATED CAPACITY AT 20 PSI IN GPM | 6297 | | |
| * Test Results Adjusted to LHG Condition | | | |
| *Adjusted Residual Pressure w/PITOT FLOW | 50 | (PSI) | |
| *Adjusted Residual Pressure w/1000 GPM | 56 | (PSI) | |
| *Adjusted Residual Pressure w/1500 GPM | 54 | (PSI) | |
| TEST CONDUCTED BY: | S. Sasenora, M. Duckworth | | |
| REVIEWED BY: | M. Duckworth | | |
| WSSC Confidential | 7322 Carroll Ave.x18 | 4/19/2017 | |



FIRE DEPT. ACCESS PLAN

DESIGNED: AMC
 CHECKED: BCG
 SCALE: AS SHOWN
 FILE NO.: 114-123
 DATE: JANUARY 2019

PROFESSIONAL CERTIFICATION
 "I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND."
 DESIGN ENGINEER SIGNATURE: *Bradley C. Job*
 DATE: JANUARY 30, 2019
 PRINTED NAME: BRADLEY CHARLES JOB
 REGISTRATION NUMBER: 38317

C4.01